

SANITARY SEWER NOTES

CONTRACTOR SHALL CONFORM TO GUIDELINES DETAILED IN THE VERMONT STATE SPECIFICATIONS. CONTRACTOR IS RESPONSIBLE FOR READING AND FOLLOWING THE FULL COMPLETE EDITION PROVIDED BY THE STATE.

- A. THE BUILDING SEWER SHALL BE CONSTRUCTED IN A MANNER WHICH WILL PREVENT LEAKING, BREAKING OR CLOGGING.
- B. SIZING AND SLOPE: MINIMUM BUILDING SEWER SIZE IS 4 INCHES (UNLESS SHOWN ON THE PLAN) AND A MINIMUM SLOPE IS 1/8" PER FOOT.
- C. CLEANOUTS: CLEANOUTS SHALL BE PROVIDED AT EACH HORIZONTAL CHANGE IN DIRECTION OF THE BUILDING SEWER GREATER THAN 45 DEGREES AND WHERE INDICATED ON THE DESIGN DRAWINGS. BUILDING SEWER CHANGES IN DIRECTION WHICH EXCEED 45 DEGREES SHOULD BE MADE WITH TWO 45 DEGREE ELLS OR LONG SWEEP FITTINGS. MANHOLES ARE ACCEPTABLE IN LIEU OF CLEANOUTS, WHERE BUILDING SEWERS ARE TO BE INSTALLED AT A DEPTH OF LESS THAN 3 FEET UNDER DRIVEWAYS ARE ANTICIPATED, EXTRA HEAVY CAST IRON PIPE SHALL BE USED.
- D. LEAKAGE: BUILDING SEWERS SHALL MEET THE LEAKAGE STANDARDS PRESCRIBED IN THE STATE OF VERMONT SPECIFICATIONS (EPR- CHAPTER 1). SEE BELOW FOR MORE DETAIL.
- E. SLOPE, VELOCITY: ALL GRAVITY SEWER LINES SHALL BE INSTALLED WITH NOT LESS THAN THE SLOPES SHOWN BELOW:

PIPE SIZE (INCHES)	SLOPE (FEET/100 FEET)
4"	2%
6"	1%
8"	0.4%

F. CHANGES IN PIPE SIZE: WHEN A SMALLER SEWER JOINS A LARGE ONE, THE INVERT OF THE LARGER SEWER SHALL BE LOWERED SUFFICIENTLY TO MAINTAIN THE SAME ENERGY GRADIENT.

G. MATERIAL: PVC SDR 35, ASTM D3034, WITH PUSH-ON GASKETED JOINTS. GASKETS SHALL CONFORM TO ASTM D3212. SEWER JOINTS SHALL BE CONSTRUCTED TO MINIMIZE INFILTRATION AND TO PREVENT THE ENTRANCE OF ROOTS INTO THE SYSTEM.

H. TRENCHING: LEDGE, ROCK, BOULDERS AND LARGE STONES SHALL BE REMOVED TO PROVIDE A MINIMUM CLEARANCE OF FOUR INCHES BELOW AND ON EACH SIDE OF ALL PIPES.

I. BEDDING: SEE TRENCH DETAIL DRAWING FOR MATERIALS. TRENCH BACKFILL SHALL BE OF A SUITABLE NATIVE MATERIAL FREE FROM DEBRIS, FROZEN MATERIAL, LARGE CLOUDS OR STONES, ORGANIC MATTER, OR OTHER UNSTABLE MATERIALS.

J. LEAKAGE TESTS: UPON COMPLETION OF SEWER LINE CONSTRUCTION, THE SEWER LINE SHALL BE TESTED IN ACCORDANCE WITH THE STATE OF VERMONT SPECIFICATIONS (EPR - CHAPTER 1, APPENDIX "A").

LEAKAGE TESTS FOR GRAVITY SEWERS

PERFORM A PRESSURIZED AIR TEST ON THE GRAVITY LINE IN ACCORDANCE WITH THE VERMONT ENVIRONMENTAL PROTECTION RULES ON EACH SECTION OF THE GRAVITY SEWER. THE ENGINEER SHALL BE GIVEN 72 HOURS NOTICE BEFORE THE TEST IS CONDUCTED. TEST MUST BE WITNESSED BY THE ENGINEER.

PLUG ALL OPENINGS IN THE TEST SECTION. ADD AIR UNTIL THE INTERNAL PRESSURE OF THE LINE IS RAISED TO APPROXIMATELY 4.0 POUNDS/SQUARE INCH (PSI) GREATER THAN THE AVERAGE PRESSURE OF ANY GROUND WATER. AFTER THIS PRESSURE IS REACHED, ALLOW THE PRESSURE TO STABILIZE. THE PRESSURE WILL NORMALLY DROP AS THE AIR TEMPERATURE STABILIZES. THIS USUALLY TAKES 2 TO 5 MINUTES DEPENDING ON THE PIPE SIZE. THE PRESSURE MAY BE REDUCED TO 3.5 PSI BEFORE STARTING THE TEST.

WHEN THE PRESSURE HAS STABILIZED AND IS AT OR ABOVE THE STARTING TEST PRESSURE OF 3.5 PSI ABOVE THE PIPE, START THE TEST. IF THE PRESSURE DROPS MORE THAN 1.0 PSI DURING THE TEST TIME, THE LINE IS PRESUMED TO HAVE FAILED THE TEST. IF A 1.0 PSI DROP DOES NOT OCCUR WITHIN THE TEST TIME, THE LINE HAS PASSED THE TEST. THE TEST TIME SHALL BE DERIVED FROM THE FOLLOWING TABLE. IF THE SECTION OF LINE TO BE TESTED INCLUDES MORE THAN ONE PIPE SIZE, CALCULATE THE TEST TIME FOR EACH SIZE AND ADD THE TEST TIMES TO ARRIVE AT THE TOTAL TEST TIME FOR THE SECTION.

PIPE SIZE (IN)	T (TIME) (MIN./100FT)
5	0.2
4	0.3
6	0.7
8	1.2

K. INSTALLATION: PIPE SHALL BE LAID WITH BELL ENDS FACING UPGRADE AND LAYING SHALL START AT THE DOWNGRADE END.

L. WATER LINE SEPARATION

a. HORIZONTAL SEPARATION: SEWERS SHALL BE LAID FLAT AT LEAST TEN FEET HORIZONTALLY FROM ANY EXISTING OR PROPOSED WATER MAIN. THE DISTANCE SHALL BE MEASURED EDGE TO EDGE.

WHERE IMPOSSIBLE OR IMPRACTICABLE TO MAINTAIN THE TEN FOOT SEWER/WATER PIPE HORIZONTAL SEPARATION, (DUE TO LEDGE, BOULDERS OR OTHER UNUSUAL CONDITIONS) THE WATER LINE MAY BE IN A SEPARATE TRENCH OR ON AN EARTH SHELVE IN THE SEWER TRENCH PROVIDED THAT THE BOTTOM OF THE WATER LINE IS AT LEAST 18 INCHES ABOVE THE TOP OF THE SEWER. WHEREVER IMPOSSIBLE OR IMPRACTICAL TO MAINTAIN THE 18 INCH VERTICAL SEPARATION, THE SEWER LINE SHALL BE CONSTRUCTED USING PRESSURE PIPE TO NORMAL WATER LINE STANDARDS AND PRESSURE TESTED TO 50 PSI FOR 15 MINUTE PRIOR TO BACKFILLING.

b. CROSSINGS: SEWERS CROSSING WATER MAINS SHALL BE LAID BENEATH THE WATER MAIN WITH AT LEAST 18 INCHES VERTICAL CLEARANCE BETWEEN THE OUTSIDE OF THE SEWER AND THE OUTSIDE OF THE WATER MAIN. WHEN IT IS IMPOSSIBLE TO MAINTAIN THE 18 INCH VERTICAL SEPARATION;

1.) THE CROSSING SHALL BE ARRANGED SO THAT ONE FULL LENGTH OF SEWER IS CENTERED ABOVE OR BELOW THE WATER LINE WITH SEWER JOINTS AS FAR AWAY AS POSSIBLE FROM WATER JOINTS;
 2.) THE SEWER PIPE MUST BE CONSTRUCTED TO WATER MAIN STANDARDS FOR A MINIMUM DISTANCE OF 20 FEET EITHER SIDE OF THE CROSSING OR A TOTAL OF THREE PIPE LENGTHS, WHICHEVER IS GREATER;
 3.) THE SECTION CONSTRUCTED TO WATER MAIN STANDARDS MUST BE PRESSURE TESTED TO MAINTAIN 50 PSI FOR 15 MINUTES WITHOUT LEAKAGE PRIOR TO BACKFILLING BEYOND ONE FOOT ABOVE THE PIPE TO ASSURE WATER TIGHTNESS;
 4.) WHERE A WATER MAIN CROSSES UNDER A SEWER, ADEQUATE STRUCTURAL SUPPORT SHALL BE PROVIDED FOR THE SEWER TO PREVENT DAMAGE TO THE WATER MAIN.

M. MANHOLES

a. DIAMETER: THE MINIMUM DIAMETER OF MANHOLES SHALL BE 48 INCHES; LARGE DIAMETERS ARE PREFERRED FOR CONNECTION TO LARGE DIAMETER SEWERS. A MINIMUM ACCESS DIAMETER OF 24 INCHES SHALL BE PROVIDED.
 b. FLOW CHANNEL: FLOW CHANNELS SHALL BE PROVIDED IN THE BASE OF ALL MANHOLES AND THE FLOW CHANNEL THROUGH MANHOLES SHOULD BE MADE TO CONFORM IN SHAPE AND SLOPE TO THAT OF THE SEWERS.
 c. MANHOLES SHALL BE OF THE PRE-CAST CONCRETE OR POUR-IN PLACE CONCRETE TYPE. MANHOLES SHALL BE WATERPROOFED ON THE EXTERIOR.
 d. INLET AND OUTLET PIPES SHALL BE JOINED TO THE MANHOLE WITH A RUBBER-GASKETED FLEXIBLE WATER TIGHT CONNECTION THAT ALLOWS DIFFERENTIAL SETTLEMENT OF THE PIPE AND MANHOLE WALL TO TAKE PLACE.
 e. ALL MANHOLES SHALL BE TESTED FOR LEAKAGE. LEAKAGE TESTING OF GRAVITY SEWERS UTILIZING THE WATER TESTING PROCEDURES TAKES INTO ACCOUNT THE LEAKAGE FROM ONE MANHOLE IN THE TEST SECTION. OTHERWISE, MANHOLES SHALL BE TESTED FOR LEAKAGE IN ACCORDANCE WITH THE FOLLOWING PROCEDURE:

AFTER THE MANHOLE HAS BEEN ASSEMBLED IN PLACE, ALL LIFTING HOLES AND EXTERIOR JOINTS SHALL BE FILLED WITH AND POINTED WITH AN APPROVED NON-SHRINKING MORTAR. ALL PIPES AND OTHER OPENINGS INTO THE MANHOLE SHALL BE SUITABLY PLUGGED AND THE PIPES PLUGGED TO PREVENT BLOWOUT.

EACH MANHOLE SHALL BE CHECKED FOR INFILTRATION BY FILLING WITH WATER TO THE TOP OF THE CONE SECTION. A STABILIZATION PERIOD OF ONE HOUR SHALL BE PROVIDED TO ALLOW FOR ABSORPTION. AT THE END OF THIS PERIOD, THE MANHOLE SHALL BE REFILLED TO THE TOP OF THE CONE. IF NECESSARY, AND THE MEASURING TIME OF AT LEAST SIX HOURS BEGIN. AT THE END OF THE TEST PERIOD, THE MANHOLE SHALL BE REFILLED TO THE TOP OF THE CONE MEASURING THE VOLUME OF WATER ADDED. THIS AMOUNT SHALL BE CONVERTED TO A 24 HOUR RATE AND THE LEAKAGE DETERMINED ON THE BASIS OF DEPTH. THE LEAKAGE FOR EACH MANHOLE SHALL NOT EXCEED ONE GALLON PER VERTICAL FOOT FOR A 24 HOUR PERIOD FOR EXFILTRATION AND THERE SHALL BE NO VISIBLE INFILTRATION. IF AN AIR TEST IS PERFORMED ON THE MANHOLE, INSTEAD OF THE WATER TEST, THE MANHOLE SHALL REMAIN UN-BACKFILLED DOWN TO THE SEWER LINE INVERTS DURING THE AIR TEST.


EXISTING UTILITIES AND UNDERGROUND STRUCTURES ARE SHOWN AS APPROXIMATE ON THE CONTRACT DOCUMENTS.

2. ALL UTILITIES SHALL BE LOCATED BY THE CONTRACTOR PRIOR TO BEGINNING CONSTRUCTION.
 3. EXISTING UTILITIES SHALL BE PROTECTED AND SUPPORTED DURING CONSTRUCTION.
 4. ALL WATER, GAS, CABLE, TELEPHONE, ELECTRIC, SEWER, AND OTHER UTILITIES FOUND TO INTERFERE WITH THE PROPOSED CONSTRUCTION SHALL BE RELOCATED IN A MANNER ACCEPTABLE TO THE ENGINEER.

PIPE BEDDING
 1. SAND BEDDING MEETING REQUIREMENTS OF EARTHWORK SPECIFICATIONS
 2. SAND BLANKET MEETING REQUIREMENTS OF EARTHWORK SPECIFICATIONS
 3. TRENCH FINAL BACKFILL MATERIAL - MATERIAL WILL EXCLUDE PIECES OF PAVEMENT, ORGANIC MATTER, TOP SOIL, ALL WET OR SOFT MUCK, PEAT, CLAY, LARGE ROCKS (12" DIMENSION), OR ANY MATERIAL DETERMINED BY THE ENGINEER THAT WILL NOT BE SUITABLE.

WATER MAINS
 1. ONCE INSTALLED PERFORM A HYDROSTATIC AND LEAKAGE TEST ACCORDING TO ANWA C600(LATEST REVISION) ON EACH PIPE LINE.
 2. THE ENGINEER AND THE WATER UTILITY SHALL BE GIVEN AT LEAST 72 HOURS NOTICE BEFORE THE TEST IS CONDUCTED. TEST MUST BE WITNESSED BY THE ENGINEER.
 3. SPECIFIED TEST PRESSURE IS 200 PSI, AND PRESSURE DURING TEST SHALL NOT VARY BY MORE THAN 5 PSI.


DUCTILE IRON PIPE: ANWA C151
 1. FITTINGS: DUCTILE IRON, STANDARD THICKNESS, 350 psi PRESSURE RATING. (ANWA C110, C153, C105, ANSI A21.10).
 2. FITTINGS: CAST IRON, 250 psi PRESSURE RATING (ANSI A21.10).
 3. TRENCH FINAL BACKFILL MATERIAL - MATERIAL WILL EXCLUDE PIECES OF PAVEMENT, ORGANIC MATTER, TOP SOIL, ALL WET OR SOFT MUCK, PEAT, CLAY, LARGE ROCKS (12" DIMENSION), OR ANY MATERIAL DETERMINED BY THE ENGINEER THAT WILL NOT BE SUITABLE.
 4. GASKETS:
 A. MECHANICAL AND PUSH-ON JOINTS. ANSI A21.11.
 F. FLANGED JOINTS: 1/8" THICK RING OR FULL FACED RUBBER, ANSI A21.15.

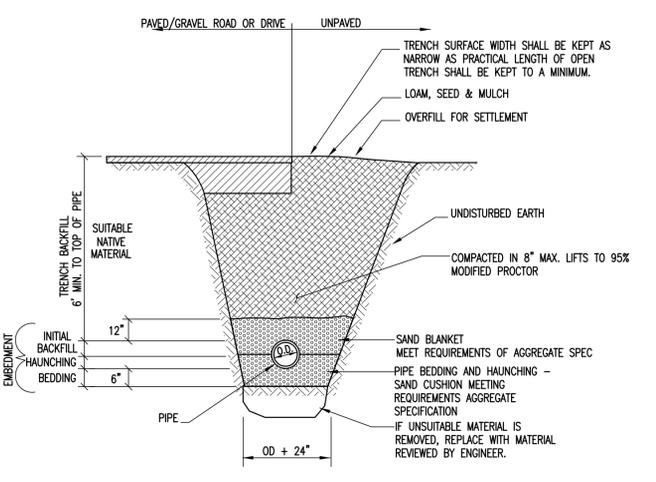

- TRENCH NOTES:**
- TRENCH TO PROVIDE A FIRM, STABLE, CONTINUOUS AND UNIFORM SUPPORT FOR THE FULL LENGTH OF PIPE.
 - PROVIDE 6" MINIMUM COVER OVER WATER PIPE.
 - INSTALL WATER PIPE IN ACCORDANCE WITH ANWA STANDARD C600.

TYPICAL WATER TRENCH DETAIL


SCALE: NONE

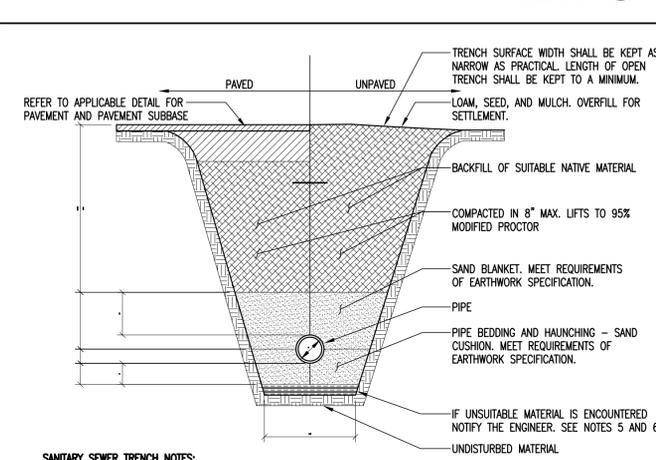

- SANITARY SEWER TRENCH NOTES:**
- UNLESS OTHERWISE NOTED, ASSUME CLASS "C" SOILS. PERFORM ALL EXCAVATIONS TO OSHA REQUIREMENTS.
 - BEDDING TO PROVIDE A FIRM, STABLE, CONTINUOUS AND UNIFORM SUPPORT FOR FULL LENGTH OF PIPE.
 - FOR BUILDING SEWERS THE MINIMUM DEPTH TO THE TOP OF THE PIPE SHALL BE 4'-0". WHERE BUILDING SEWERS ARE TO BE INSTALLED AT A DEPTH LESS THAN 3'-0" UNDER DRIVEWAYS, EXTRA HEAVY CAST IRON OR OTHER HIGH STRENGTH PIPE SHALL BE USED. OTHERWISE, REFER TO INSULATION OVER SHALLOW SEWER LINE DETAIL.
 - FOR SEWER COLLECTION SYSTEMS THE MINIMUM DEPTH TO THE TOP OF THE PIPE SHALL BE 5'-0". THIS DEPTH SHALL BE INCREASED TO 6'-0" IN AREAS TO BE PLOWED DURING THE WINTER MONTHS. OTHERWISE, REFER TO INSULATION OVER SHALLOW SEWER LINE DETAIL.
 - BACKFILL SHALL BE OF A SUITABLE MATERIAL REMOVED FROM EXCAVATION EXCEPT WHERE OTHER MATERIAL IS SPECIFIED. DEBRIS, FROZEN MATERIAL, LARGE CLOUDS OR STONES, ORGANIC MATTER, OR OTHER UNSTABLE MATERIALS SHALL NOT BE USED FOR BACKFILL WITHIN TWO FEET OF THE TOP OF THE PIPE.
 - LEDGE, ROCK, BOULDERS AND LARGE STONES SHALL BE REMOVED TO PROVIDE A MINIMUM CLEARANCE OF FOUR INCHES BELOW AND ON EACH SIDE OF ALL PIPES.
 - SEWERS ON 20 PERCENT SLOPES OR GREATER SHALL BE ANCHORED SECURELY WITH CONCRETE ANCHORS OR EQUIVALENT, SPACED AS FOLLOWS:
 A. NOT OVER 36 FEET CENTER TO CENTER ON GRADES 20 PERCENT AND UP TO 35 PERCENT
 B. NOT OVER 24 FEET CENTER TO CENTER ON GRADES 35 PERCENT AND UP TO 50 PERCENT
 C. NOT OVER 16 FEET CENTER TO CENTER ON GRADES 50 PERCENT AND OVER

SANITARY SEWER TRENCH DETAIL

SCALE: NONE

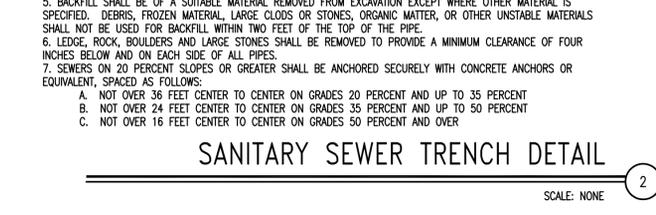

WATER NOTES

- GENERAL**
- METERS FOR SERVICE CONNECTIONS 3/4" OR SMALLER WILL BE PROVIDED BY THE WATER UTILITY, BUT INSTALLED BY THE CONTRACTOR.
 - WATER SYSTEM COMPONENTS ARE TO BE LEAD FREE.
 - A REPRESENTATIVE FOR THE WATER UTILITY MUST BE PRESENT, UNLESS OTHERWISE NOTIFIED IN WRITING, FOR ALL WATER MAIN TAPS.
 - WATER INFRASTRUCTURE IS TO INCLUDE SWING TESTS. "AS BUILT" DRAWINGS SHALL BE PREPARED BY THE CONTRACTOR WHICH REFLECT ACTUAL UTILITY LOCATIONS AND RESULTING EASEMENTS AT THE TIME OF COMPLETION OF THE SYSTEM.
 - THE WATER UTILITY SHALL INSPECT ALL ITEMS TO BE TAKEN OVER BY THE TOWN PRIOR TO ACCEPTANCE.
 - THE CONTRACTOR SHALL PROVIDE A 2 YEAR WARRANTY ON ALL WATER RELATED ITEMS FROM THE TIME OF COMPLETION OF THE PROJECT.


EXISTING UTILITIES AND UNDERGROUND STRUCTURES ARE SHOWN AS APPROXIMATE ON THE CONTRACT DOCUMENTS.

2. ALL UTILITIES SHALL BE LOCATED BY THE CONTRACTOR PRIOR TO BEGINNING CONSTRUCTION.
 3. EXISTING UTILITIES SHALL BE PROTECTED AND SUPPORTED DURING CONSTRUCTION.
 4. ALL WATER, GAS, CABLE, TELEPHONE, ELECTRIC, SEWER, AND OTHER UTILITIES FOUND TO INTERFERE WITH THE PROPOSED CONSTRUCTION SHALL BE RELOCATED IN A MANNER ACCEPTABLE TO THE ENGINEER.

PIPE BEDDING
 1. SAND BEDDING MEETING REQUIREMENTS OF EARTHWORK SPECIFICATIONS
 2. SAND BLANKET MEETING REQUIREMENTS OF EARTHWORK SPECIFICATIONS
 3. TRENCH FINAL BACKFILL MATERIAL - MATERIAL WILL EXCLUDE PIECES OF PAVEMENT, ORGANIC MATTER, TOP SOIL, ALL WET OR SOFT MUCK, PEAT, CLAY, LARGE ROCKS (12" DIMENSION), OR ANY MATERIAL DETERMINED BY THE ENGINEER THAT WILL NOT BE SUITABLE.

WATER MAINS
 1. ONCE INSTALLED PERFORM A HYDROSTATIC AND LEAKAGE TEST ACCORDING TO ANWA C600(LATEST REVISION) ON EACH PIPE LINE.
 2. THE ENGINEER AND THE WATER UTILITY SHALL BE GIVEN AT LEAST 72 HOURS NOTICE BEFORE THE TEST IS CONDUCTED. TEST MUST BE WITNESSED BY THE ENGINEER.
 3. SPECIFIED TEST PRESSURE IS 200 PSI, AND PRESSURE DURING TEST SHALL NOT VARY BY MORE THAN 5 PSI.

DUCTILE IRON PIPE: ANWA C151
 1. FITTINGS: DUCTILE IRON, STANDARD THICKNESS, 350 psi PRESSURE RATING. (ANWA C110, C153, C105, ANSI A21.10).
 2. FITTINGS: CAST IRON, 250 psi PRESSURE RATING (ANSI A21.10).
 3. TRENCH FINAL BACKFILL MATERIAL - MATERIAL WILL EXCLUDE PIECES OF PAVEMENT, ORGANIC MATTER, TOP SOIL, ALL WET OR SOFT MUCK, PEAT, CLAY, LARGE ROCKS (12" DIMENSION), OR ANY MATERIAL DETERMINED BY THE ENGINEER THAT WILL NOT BE SUITABLE.
 4. GASKETS:
 A. MECHANICAL AND PUSH-ON JOINTS. ANSI A21.11.
 F. FLANGED JOINTS: 1/8" THICK RING OR FULL FACED RUBBER, ANSI A21.15.

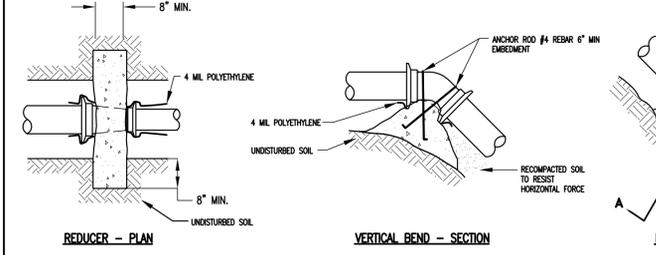


REDUCER - PLAN

VERTICAL BEND - SECTION

PIPE DIA.	MINIMUM BEARING SURFACE (SF) 150 PSI WORKING PRESSURE					
	TEE	90° BEND	45° BEND	22.5° BEND	11.25° BEND	END CAP
1,000 PSF SOIL BEARING CAPACITY	16	16	10	4	2	16
3,000 PSF SOIL BEARING CAPACITY	7	7	4	2	1	7
5,000 PSF SOIL BEARING CAPACITY	3	3	1	0.5	0.5	3
10,000 PSF SOIL BEARING CAPACITY	1	1	0.5	0.5	0.5	1
15,000 PSF SOIL BEARING CAPACITY	1	1	1	1	1	1
20,000 PSF SOIL BEARING CAPACITY	1	1	1	1	1	1
25,000 PSF SOIL BEARING CAPACITY	1	1	1	1	1	1
30,000 PSF SOIL BEARING CAPACITY	1	1	1	1	1	1
35,000 PSF SOIL BEARING CAPACITY	1	1	1	1	1	1
40,000 PSF SOIL BEARING CAPACITY	1	1	1	1	1	1
45,000 PSF SOIL BEARING CAPACITY	1	1	1	1	1	1
50,000 PSF SOIL BEARING CAPACITY	1	1	1	1	1	1

TYPICAL BEARING THRUST BLOCK

SCALE: NONE

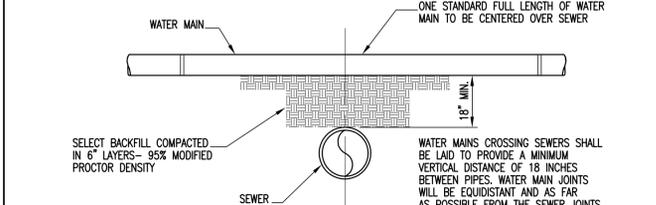


WATER MAIN ABOVE SEWER

SCALE: NONE

SEPARATION NOTES:
 1. WATER MAIN RELATIONS TO SEWER SHALL BE IN ACCORDANCE WITH THE "RECOMMENDED STANDARDS FOR WATER WORKS" SO-CALLED TEN STATE STANDARDS.
 2. WATER MAINS SHALL BE LAID AT LEAST 10 FEET HORIZONTALLY FROM ANY EXISTING OR PROPOSED SEWERS. THE DISTANCE SHALL BE MEASURED EDGE TO EDGE. IF THIS DISTANCE CANNOT BE OBTAINED, THEN THE PIPES SHALL BE INSTALLED IN A SEPARATE TRENCH AT AN ELEVATION SO THE BOTTOM OF THE WATER MAIN IS AT LEAST 18 INCHES ABOVE THE TOP OF THE SEWER.
 3. WHEN IT IS IMPOSSIBLE TO MAINTAIN 18" VERTICAL SEPARATION OR WHERE THE SEWER MUST BE LAID ABOVE THE WATER MAIN; 1) THE CROSSING SHALL BE ARRANGED SO THAT ONE FULL LENGTH OF SEWER IS CENTERED ABOVE OR BELOW THE WATER LINE WITH SEWER JOINTS AS FAR AS POSSIBLE FROM WATER JOINTS; 2) THE SEWER PIPE MUST BE CONSTRUCTED TO WATER MAIN STANDARDS FOR A MINIMUM DISTANCE OF 20 FEET EITHER SIDE OF THE CROSSING OR A TOTAL OF THREE PIPE LENGTHS, WHICHEVER IS GREATER; 3) THE SECTION CONSTRUCTED TO WATER MAIN STANDARDS MUST BE PRESSURE TESTED TO MAINTAIN 50 PSI FOR 15 MINUTES WITHOUT LEAKAGE PRIOR TO BACKFILLING BEYOND ONE FOOT ABOVE THE PIPE TO ASSURE WATER TIGHTNESS.

TYPICAL SEWER/WATER SEPARATION DETAIL

SCALE: NONE

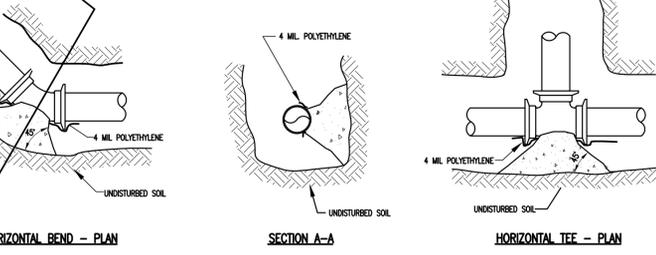

HORIZONTAL BEND - PLAN

SECTION A-A

HORIZONTAL TEE - PLAN

CAPPED STUB WITH VALVE - PLAN

TYPICAL BEARING THRUST BLOCK


SCALE: NONE

THRUST BLOCK NOTES:

- THRUST BLOCKS SHALL BE PROVIDED AT ALL WATER LINE TEES, HYDRANTS, BENDS, REDUCERS, AND END CAPS.
- HYDROSTATIC AND LEAKAGE TEST PRESSURE PER SPECIFICATIONS.
- PLACE 4 MIL POLYETHYLENE BETWEEN FITTINGS AND THRUST BLOCKS.
- CONCRETE SHALL HAVE 4000 PSI MINIMUM COMPRESSIVE STRENGTH AT 28 DAYS AND AIR ENTRAINMENT OF 4 TO 8% BY VOLUME.
- UTILIZE MEGALUG MECHANICAL JOINT RESTRAINTS ON ALL FITTINGS IN ADDITION TO CONCRETE THRUST BLOCKS.

TYPICAL BEARING THRUST BLOCK

SCALE: NONE

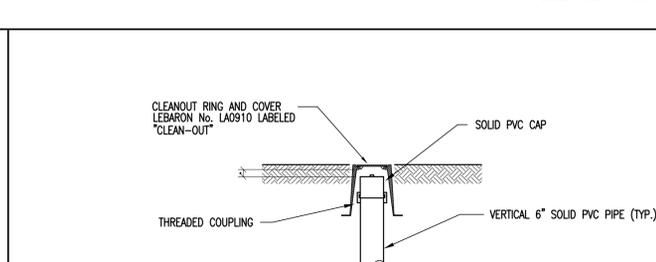

SEWER CLEANOUT DETAIL

SCALE: NONE

ISSUED FOR PERMIT REVIEW 2/27/15
 REVISED 5/15/15

SEWER CLEANOUT DETAIL

SCALE: NONE

TAPPING VALVES

- TAPPING VALVES TO MEET ANSI/ANWA C509-87, STANDARD FOR RESILIENT SEATED GATE VALVES.
- VALVES SHALL HAVE A MINIMUM WORKING PRESSURE OF 150 PSI.
- VALVES SHALL OPEN RIGHT.
- INLET FLANGES SHALL BE CLASS 125, ANSI B16.1, OR ANSI/ANWA C110/A21.10.
- OUTLET CONNECTION: STANDARDIZED MECHANICAL JOINT.
- STEM SEALS: O-RING.
- STEM CONSTRUCTION: NON-RISING.
- SEATING: PARALLEL SEAT.
- END CONNECTIONS: MECHANICAL ON RUN, FLANGED ON BRANCH.
- BURIED TAPPING VALVES SHALL BE PROVIDED WITH A 2 INCH SQUARE WRENCH NUT AND CAST IRON VALVE BOX. IF DEPTH FROM GRADE TO TOP OF VALVE OPERATING NUT IS GREATER THAN 6'-0" VALVE STEM RISER MADE OF HIGH STRENGTH STEEL SHALL BE PROVIDED. DEPTH FROM VALVE STEM NUT TO GRADE WILL BE 4 TO 6 FEET.

TAPPING SLEEVES

- ANWA C509, LATEST REVISION.
- ANWA C207, CLASS D, MAX. WORKING PRESSURE OF 150 PSI.
- SLEEVES: SPLIT SLEEVES OF CAST IRON OR DUCTILE IRON.
- MECHANICAL JOINT ENDS WITH END AND GASKET SEALS.
- PROVIDE A 3/4" NPT TEST PLUG OR OTHER PROVISION FOR AIR TESTING THE VALVE AND SLEEVE AT MAXIMUM WORKING PRESSURE.
- BOLTS AND NUTS, MECHANICAL JOINTS: HIGH STRENGTH CAST IRON OR HIGH STRENGTH LOW ALLOY STEEL, ANSI/ANWA C111/A21.11-90.
- BOLTS AND NUTS, FLANGED JOINTS: HIGH STRENGTH, LOW CARBON STEEL CONFORMING TO ANSI/ANWA C110/A21.10-87, APPENDIX A.
- COAT ALL NUTS AND BOLTS WITH A RUST RESISTANT LUBRICANT.
- ALL BOLTS AND NUTS USED WITH PIPE SLEEVES SHALL BE BRUSH COATED HEAVILY AFTER FINAL TIGHTENING WITH BITUMASTIC COLD-APPLIED MATERIAL TO THOROUGHLY COVER ALL EXPOSED SURFACES OF BOLTS AND NUTS.

VALVE BOXES

- ACCEPTABLE MANUFACTURER'S: MUELLER, CLOW, OR EQUAL.
- CLOW F-2452 SLIDING TYPE, TWO PIECE, OR EQUAL.
- 5 1/4" INCH SHAFT.
- SIZE 664-A (40-60 INCH OVERALL LENGTH).
- CAST IRON.
- CLOW F-2490 LBS OR EQUAL.
- THE WORD "WATER" TO BE CAST INTO TOP OF COVERS, AND ARROW SHOWING DIRECTION OF OPENING.

Stamp

Rev. No.	Description	DATE
1	REVISED PER DAB & CONSERVATION BOARD COMMENTS/MEETINGS	5/15/15

ENGINEERING VENTURES PC
 208 Flynn Avenue, Suite 214 Burlington, VT 05401
 Tel: 802-865-6225 • Fax: 802-865-6386
 85 Fletcher Street, Suite 100 Burlington, VT 05401
 Tel: 802-442-3339 • Fax: 802-442-9331
 www.engineeringventures.com

NATHANIEL HAYWARD
 302 Mountain View Drive
 Suite 300 Colchester, VT 05446
 (802) 578-5078

Water and Wastewater Details

380 Colchester Avenue
 Burlington, VT

Designed By: MD/KW
 Checked By: KW
 Drawn By: MD
 Scale: N.T.S.
 Date: 02/27/15

ISSUED FOR PERMIT REVIEW 2/27/15
 REVISED 5/15/15

C2.1
 EV#14062